



NOTES

1. PROVIDE BUILDING I.D. ON REMOTE FIRE DEPT. CONNECTION.
2. NO TREES, BUSHES OR WALLS WITHIN 5' RADIUS OF FIRE DEPT. CONNECTION
3. IF FIRE SPRINKLER DESIGN INDICATES DEMAND OF 1000 GPM OR GREATER, THE UNDERGROUND FIRE DEPT. CONNECTION LINE SHALL BE INCREASED TO 6" DIAMETER WITH A THREE WAY 2½" FIRE DEPT. HOSE CONNECTION
4. 4' MIN. TO BACK OF CURB, OR 2' MIN TO BACK OF SIDEWALK, OR WHEN NO CURB, 4' MAX. OUTSIDE THE CLEAR ZONE.
5. PIPE BELOW GROUND LEVEL SHALL BE POLYWRAPED PER SEC 610.
6. ALL PIPE SHALL BE AWWA C-150 CLASS 350 DIP.
7. ALL JOINTS SHALL BE MEGA-LUG RESTRAINED OR APPROVED EQUAL.

2½" X 2½" X 4"
FIRE DEPARTMENT
CONNECTION NST



TOP VIEW

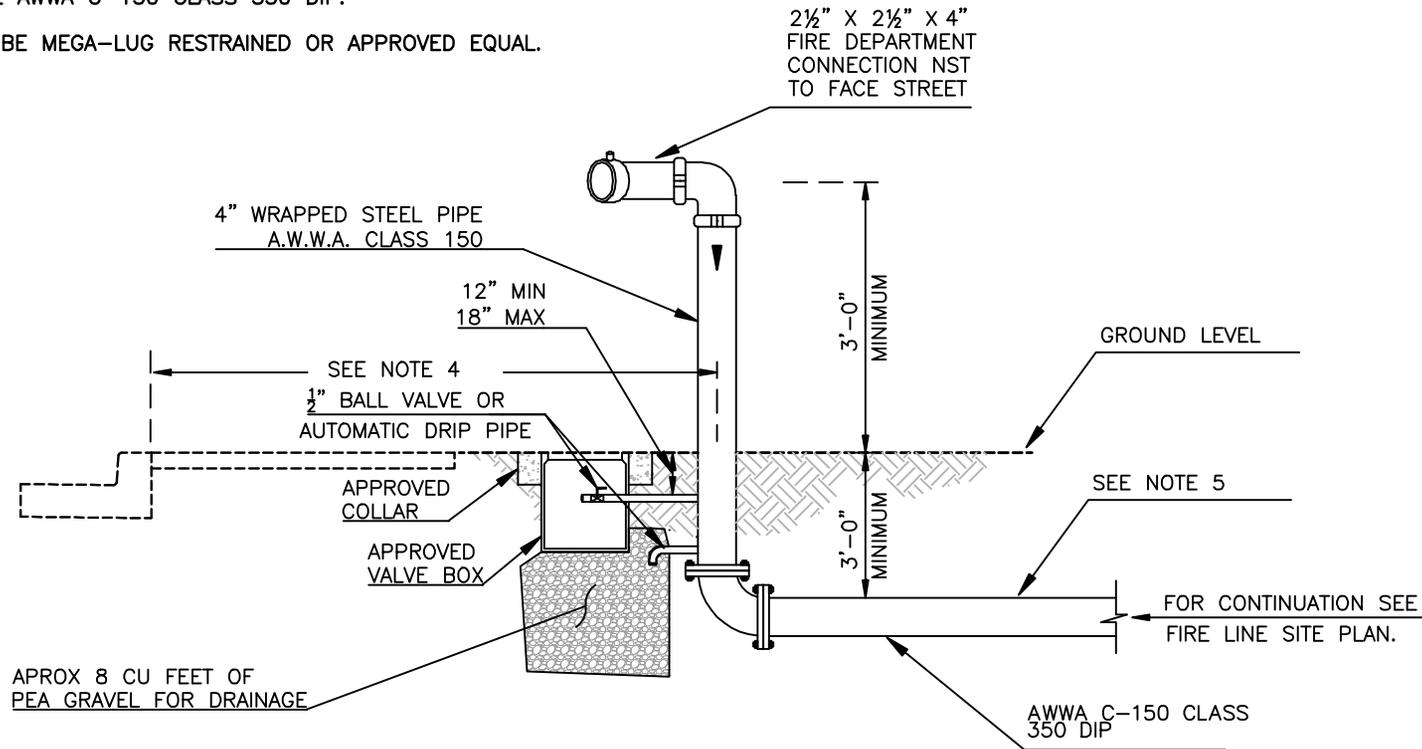

N.T.S.

DETAIL NO. 363	STANDARD DETAIL	REMOTE FIRE DEPT. CONNECTION	CITY OF KINGMAN	DETAIL NO. 363
--------------------------	------------------------	-------------------------------------	------------------------	--------------------------